



ADA Transition Plan



Monroe County, Tennessee Government

105 College St. South, Suite 1. Phone: (423) 442-3981
Madisonville, TN 37354 Website: monroetn.com

TABLE OF CONTENTS

Executive Summary _____	3
1. Purpose _____	3
2. Implementation _____	3
3. Expectation _____	3
Letter of Commitment from the Mayor _____	4
Administrative Information _____	5-7
1. Introduction _____	5
2. Notice Under the Americans with Disabilities Act _____	6
3. Monroe County Grievance Procedures Under the ADA _____	7
Adoption of ADA Transition Plan - Resolution No. 0827-7 _____	8-9
Plan of Implementation _____	1a-26a
1. Courthouse _____	1a-4a
2. J.P. Kennedy _____	5a-13a
3. Airport _____	14a-16a
4. Visitor Center _____	17a-18a
5. Election Commission _____	19a
6. Health Department/Dental Clinic _____	20a-21a
7. Highway Department/911 Center _____	22a-23a
8. Witt Judicial Complex _____	24a-26a
G.I.S. Surveys and Drawings _____	1b-13b
1. Courthouse and J.P. Kennedy _____	1b
Courthouse - Basement _____	2b
Courthouse - 1 st Floor _____	3b
Courthouse - 2 nd Floor _____	4b
J.P. Kennedy - Basement _____	5b
J.P. Kennedy - 1 st Floor _____	6b
2. Airport - Aerial View _____	7b
3. Visitor Center - Aerial View _____	8b
4. Election Commission - Aerial View _____	9b
Election Commission-Ground Floor _____	10b
5. Health Dept.-Dental Clinic-Hwy Department/911 Center-Aerial View _____	11b
6. Witt Judicial Complex-Aerial View _____	12b
Witt Judicial Complex-Ground Floor _____	13b

EXECUTIVE SUMMARY

Purpose

The purpose of the Americans with Disabilities Act (ADA) Transition Plan is to develop policies and practices for implementing physical pedestrian improvements within Monroe County's public right-of-way. The county's goal is to optimize pedestrian accessibility, to provide safe and usable pedestrian facilities for all pedestrians, and to ensure compliance with all federal, state, and local regulations and standards. The ADA requires all public agencies to develop an ADA Transition Plan for the accessibility of all county owned buildings. The main purpose of this ADA Transition Plan is to describe the current status of these building and to outline the recommended procedures for implementing and scheduling remedial work to achieve compliance. The ADA Transition Plan covers Monroe County Government in its entirety. The county has a wide variety of facilities within the public right-of-way.

Implementation

This report is the 2019 version of Monroe County's ADA Transition Plan. This report was initiated by the Monroe County Mayor's staff and was developed, in part, with the help and guidance of the Federal Highway Administration (FHWA) and the Tennessee Department of Transportation (TDOT). The ADA Transition Plan is intended to represent both the legal and functional goals and objectives of the county to make the existing pedestrian facilities within the county's right-of-way accessible and usable for persons with disabilities. By 2020, Monroe County intends on organizing and meeting with an ADA Citizens Task Force on a quarterly basis. The meetings are intended to understand and address ADA items that may fall outside of the scope of this right-of-way document, but are important to address. These items may include better accessibility to county buildings, programs, and services. It may also involve developing methods to better educate the community on issues involving accessibility.

Expectation

Monroe County is recognized as being one of the best areas to live in Tennessee, and it is important that this is true for all residents. The county's goal is to optimize pedestrian accessibility and to provide safe and usable pedestrian facilities for all residents. It is through the ongoing efforts of the ADA Transition Plan that the county will continue to ensure that it is one of the most livable, accessible, and best places to live in the State of Tennessee.

MITCH INGRAM

MONROE COUNTY MAYOR

June 7, 2019

Margaret Z. Mahler
ADA Compliance
Tennessee Dept. of Transportation
505 Deaderick St., Suite 400
Nashville, TN 37243

RE: ADA Compliance and Self-Certification

Mrs. Mahler,

Monroe County is committed to taking the necessary steps to complete a workable and acceptable ADA Transition Plan. We are actively identifying areas, programs, and facilities throughout the County that do not currently meet ADA accessibility requirements and standards. Many of the non-compliant issues that have been identified to date are easily correctible and will be taken care of by our Director of Maintenance and ADA Coordinator Mr. Brandon West. Though the previous administration did not begin this process when necessary, Mr. West and various members of my staff have worked, and will continue to work, tirelessly to comprise and adhere to the following documentation and actions by December of 2019:

1. Designation of an ADA Coordinator.
2. Provide Notice to the Public About ADA Requirements.
3. Establish a Grievance Procedure.
4. Develop Internal Design Standards, Specifications, and Details.
5. Assign Personnel for the Development of a Transition Plan.
6. Approve a Schedule and Budget for the Transition Plan; and
7. Monitor the Progress of the Implementation of the Transition Plan.

If there is anything else that my administration may do to ensure complete ADA compliance, please do not hesitate to reach out.

Best,



Mitch Ingram
Monroe County Mayor

ADMINISTRATIVE INFORMATION

1. Introduction

The Americans with Disabilities Act (ADA) of 1990 is a civil rights statute that prohibits discrimination against people who have disabilities. Monroe County, Tennessee, as a Local Public Agency (LPA) with more than 50 employees, is required by the U.S. Department of Justice (USDOJ) and the Federal Highway Administration (FHWA) to ensure that all public right-of-way is accessible for all pedestrians with disabilities. This authority stems from Section 504 of the Rehabilitation Act of 1973 (29 U.S.C. § 794) and the Americans with Disabilities Act of 1990 (42 U.S.C. § 12131-12164). The Tennessee Department of Transportation has provided guidance for Monroe County, and all of Tennessee's LPAs, in relation to the requirements set by the ADA and FHWA. To be eligible for federal transportation funding, Monroe County, Tennessee must have an operating ADA Transition Plan completed by the end of 2019. This document will be submitted to and held by the Monroe County Board of Commissioners. The standards for compliance are the 2010 Americans with Disabilities Act Accessibility Guidelines (ADAAG).

Monroe County, Tennessee has accomplished the following steps relative to the Americans with Disabilities Act Transition Plan:

1. Designation of an ADA Coordinator.
2. Provide Notice to the Public About ADA Requirements.
3. Establish a Grievance Procedure.
4. Develop Internal Design Standards, Specifications, and Details.
5. Assign Personnel for the Development of a Transition Plan.
6. Approve a Schedule and Budget for the Transition Plan; and
7. Monitor the Progress of the Implementation of the Transition Plan.

These documents and the procedural details of Monroe County's Transition Plan are included in this report and are available on the county's Website.

ADMINISTRATIVE INFORMATION

2. Notice under the Americans with Disabilities Act

Monroe County, Tennessee

Effective: June, 2019

In accordance with the requirements of Title II of the Americans with Disabilities Act (ADA) of 1990, Monroe County, Tennessee will not discriminate against qualified individuals with disabilities on the basis of disability in its service, programs, or activities.

Employment: Monroe County does not discriminate on the basis of disability in hiring or employment practices, and complies with all regulations promulgated by the U.S. Equal Employment Opportunity Commission under Title I of the ADA.

Effective Communication: Monroe County will generally, upon request, provide appropriate aids and services leading to effective communication for qualified persons with disabilities, so they can participate equally in Monroe County's programs, services, and activities, including qualified sign language interpreters, documents in Braille, and other ways of making information and communicators accessible to people who have speech, hearing, or vision impairments.

Modification to Policies and Procedures: Monroe County will make all reasonable modifications to policies and programs to ensure that people with disabilities have an equal opportunity to enjoy all of its programs, services, and activities.

For example: Individuals with service animals are welcomed in all Monroe County offices, even where pets are generally prohibited.

Anyone who requires an auxiliary aid or service for effective communication, or modification of policies or procedures to participate in a program, service, or activity, should contact the county's ADA Coordinator, Brandon West, by phone at (423) 572-2582, or by email at brandon.west@monroetn.com, no later than 48 hours before the scheduled event.

Our Responsibilities: The ADA does not require Monroe County to take any action that would fundamentally alter the nature of its programs or services, or impose an undue financial or administrative burden. However, Monroe County will not place a surcharge on a particular individual with a disability, or any group of individuals with disabilities, to cover the cost of providing auxiliary aid/services or reasonable modifications of policy.

To submit a Complaint concerning programs, services, or activities, please refer to the "Monroe County Grievance Procedures" form at:

<https://monroetn.com/grievance-procedure-under-the-americans-with-disabilities-act/#wpcf7-f8719-p8736->

ADMINISTRATIVE INFORMATION

3. Grievance Procedure Under the Americans with Disabilities Act

This Grievance Procedure is established to meet the requirements of the Americans with Disabilities Act of 1990. It may be used by anyone who wishes to file a complaint alleging discrimination on the basis of disability in the provision of services, activities, programs, or benefits by Monroe County, Tennessee. The county's personnel policy governs employment-related complaints of disability discrimination.

The complaint should be submitted in writing or via online forum, and contain information about the alleged discrimination such as name, address, phone number of complainant and location, date, and description of the problem should be included. Alternative means of filing complaints, such as personal interviews or a tape recording of the complaint will be made available for persons with disabilities upon request.

The complaint should be submitted by the grievant and/or his/her designee as soon as possible but no later than 60 calendar days after the alleged violation, online at <https://monroetn.com/grievance-procedure-under-the-americans-with-disabilities-act/#wpcf7-f8719-p8736> or in writing to:

Brandon West
ADA Coordinator
105 College St. South, Suite 1.
Madisonville, TN 37354
Phone: (423) 572-2582
Email: brandon.west@monoretn.com

Within 15 calendar days after receipt of the complaint, the ADA Coordinator or his/her designee will meet with the complainant to discuss the complaint and the possible resolutions. Within 15 days of the meeting, the ADA Coordinator or his/her designee will respond in writing, and where appropriate, in a format accessible to the complainant, such as large print, Braille, or audio tape. The response will explain the position of Monroe County and offer a substantive resolution of the complaint.

If the response by the ADA Coordinator or his/her designee does not satisfactorily resolve the issue, the complainant and/or his/her designee may appeal the decision within 15 calendar days after receipt of the response to the County Mayor or his/her designee.

Within 15 calendar days after receipt of the appeal, the Mayor or his/her designee will meet with the complainant to discuss the complaint and possible resolutions. Within 15 calendar days after the meeting, the Mayor or his/her designee will respond in writing, and, where appropriate, in a format accessible to the complainant, with a final resolution of the complaint.

All written or online complaints received by the ADA Coordinator or his/her designee, appeals to the Mayor or his/her designee, and responses from the two offices will be retained by Monroe County for no less than three years.

Resolution # 0827-7**RESOLUTION OF THE GOVERNING BODY
OF MONROE COUNTY, TENNESSEE, ADOPTING THE AMERICANS WITH
DISABILITIES ACT (ADA) TRANSITION PLAN AND PROCEDURES**

On August 27th, 2019, on behalf of the citizens of Monroe County, Tennessee, the Monroe County Board of Commissioners state and accept the following:

WHEREAS, the federal government enacted the Americans with Disabilities Act of 1990 (ADA) to prevent discrimination of the physically and mentally disabled in relation to employment and access to public facilities;

WHEREAS, in compliance with Title II of the ADA, the County of Monroe shall adopt the following procedures and actions prescribed in the ADA Transition Plan, a copy of which is attached hereto.

1. Designation of an ADA Coordinator.
2. Provide Notice to the Public About ADA Requirements.
3. Establish a Grievance Procedure.
4. Develop Internal Design Standards, Specifications, and Details.
5. Assign Personnel for the Development of a Transition Plan.
6. Approve a Schedule and Budget for the Transition Plan; and
7. Monitor the Progress of the Implementation of the Transition Plan.

Therefore, the following is hereby established:

SECTION I

The ADA Coordinator is appointed to that position by the County Mayor, and must be an employee of Monroe County. Brandon West, Monroe County Maintenance Director, is designated as the current ADA Coordinator for Monroe County.

SECTION II

The "Notice Under the Americans with Disabilities Act", a copy of which is attached hereto, is adopted as the Notice of the County under the Americans with Disabilities Act.

SECTION III

The "ADA Grievance Procedure Under the Americans with Disabilities Act", a copy of which is attached hereto, is adopted by the County as the grievance procedure for addressing complaints alleging discrimination on the basis of disability in the provision of services, activities, programs, or benefits by the county.

SECTION IV

In compliance with Federal and State laws as set forth above, the Board of Commissioners resolves to post the required information regarding the ADA Coordinator, the "Notice under the Americans with Disabilities Act", and Monroe County's "Grievance Procedure under the Americans with Disabilities Act" on its website, and at such other locations as may be determined from time to time.

SECTION V

The Mayor's staff, in conjunction with the Maintenance Department, is responsible for the development, scheduling, and implementation of the ADA Transition Plan. The Plan of Implementation, outlined by building in pages 1a through 26a of the ADA Transition Plan, may be modified at the discretion of both the ADA Coordinator and the Mayor, acting in accordance with each other, for reasons of financial or administrative conflicts.

SECTION VI

No part of the Resolution shall be interpreted to conflict with any local, state, or federal laws.

SECTION VII

Now, therefore be it resolved by the Monroe County Commission, meeting in regular session this 27th day of August, 2019 at the Monroe County Courthouse in Madisonville, Tennessee, that Monroe County, Tennessee is committed to the adoption of the submitted ADA Transition Plan and the associated cost, as detailed in the Transition Plan, which will be allocated in the budget, beginning in the fiscal year 2020-2021.

This resolution shall become effective upon promulgation according to law.

Passed, this 27th Day of August, 2019



Mitch Ingram

Mitch Ingram, Chairman

ATTEST:

Larry C. Sloan

Larry C. Sloan, County Clerk

PASSED THIS 27th day of August , 2019

It was moved by Commissioner Harrill, seconded by Commissioner Thomas, that this resolution be approved as presented. Aye 9 Nay _____

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Courthouse¹

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate ²	Source of Funding
South-West-Side Parking, ³ Corner Handicap Spot.	In accordance with sections 1.3 and 1.11 of the Self-Evaluation, the parking spot is considered Van Accessible, but there is no signage designating such.	Add sign that reads "Van Assessable" to the pole that bears the International Symbol of Accessibility. (Bottom of both signs have to be 60" above the ground).	Phase 1	Maintenance Department	\$150	County Maintenance Budget: Line 599-ADA Compliance
Top of Courthouse Ramp, Both Sides of Railing. ⁴	In accordance with section 1.35 of the Self-Evaluation, the railing does not extend 12" passed the end of the ramp.	Add 12" of railing on each side of the ramp to connect to the wall.	Phase 2	Maintenance Department	\$160	County Maintenance Budget: Line 599-ADA Compliance
Courthouse Ramp. ⁵	In accordance with section 1.36 of the Self-Evaluation, the surface of the ramp does not extend passed the railing 12".	However, due to the ramp being solid concrete and brick, it is infeasible to make this minor alteration.	N/A	N/A	N/A	N/A
Front of Courthouse and In Front of Disabled	In accordance with section 1.39 of the Self-Evaluation, all	Add signage to Front of Courthouse and all handicap parking spaces				County Maintenance Budget:

¹ Pg. 1b, A

² At Time of Transition Plan Adoption.

³ Pg. 1b, D1

⁴ Pg. 3b, A

⁵ Pg. 3b, B

Parking Spaces (If they are outside of accessible route view). ⁶	inaccessible entrances into the Courthouse do not have signage designating the nearest accessible route.	outside of the view of the slope. Should distinguish the department that accessible route is cleared for (Archives, Vet. Services, Etc.). ⁷	Phase 1	Maintenance Department	\$360	Line 599-ADA Compliance
Some Doors in Courthouse.	In accordance with sections 2.43 and 3.9 of the Self-Evaluation, every door in the Courthouse should be assessable without the twisting of the wrist, etc.	Some entrances to offices, Restrooms, etc., in the Courthouse still use classic door knobs, replace these with door levers. ⁸	Phase 1	Maintenance Department	\$155	County Maintenance Budget: Line 599-ADA Compliance
Courtroom (2 nd Floor). ⁹	In accordance with section 2.52 of the Self-Evaluation, there is no designated wheelchair space in the Courtroom. ¹⁰	Designate Wheelchair space in Courtroom.	Phase 2	Maintenance Department	\$250	County Maintenance Budget: Line 599-ADA Compliance
Courthouse, 1 st Floor Foyer. ¹¹	In accordance with several subsections of section 4 of the Self-Evaluation, the drinking fountains are not ADA compliant.	Install new drinking fountains.	Phase 3	Maintenance Department	\$600	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Restroom 1st Floor¹²						
Outside Restroom, Wall. ¹³	In accordance with section 3.5 of the Self-Evaluation, an Air Vent is blocking the floor from being clear.	It is infeasible to move the Air Vent.	N/A	N/A	N/A	N/A

⁶ Pg. 1b, C, D1, D2, D3, D4 - Pg. 2b, A - Pg. 3b, C1 C2

⁷ Subject to change upon move to new Justice Center.

⁸ Subject to change upon Security Upgrades.

⁹ Pg. 4b, A

¹⁰ Subject to Change upon Transition into Justice Center.

¹¹ Pg. 3b, F

¹² Pg. 3b, G

¹³ Pg. 3b, H

	In accordance with sections 3.7, 3.15, 3.17, 3.18, 3.31, 3.47 of the Self-Evaluation, there is not sufficient maneuvering clearance in the Restroom.	Remove Privacy Stall.	Phase 1	Maintenance Department	N/A	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.19 of the Self-Evaluation, the Mirror in the Restroom is more than 40" above the floor.	Install longer mirror, with bottom of mirror no higher than 40" above the floor.	Phase 1	Maintenance Department	\$70	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.26 of the Self-Evaluation, there is no cover panel over the sink pipes.	Install Pipe Cover Panel.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is over 44" from the floor.	Reposition paper towel dispenser so that it is no less than 20" from the sink, and no more than 44" from the floor.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.34 of the Self-Evaluation, there is no rear grab bar.	Install rear grab bar 12" from the centerline of the toilet, is 36" long, at least 24" on the open side, and between 33" and 36" from the Floor. (If feasible)	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
Area: Women's Restroom, 1st Floor¹⁴						
Outside Wall, Right of Woman's Restroom/Courthouse Hall way. ¹⁵	In accordance with section 3.2 of the Self-Evaluation, there are no signs on the first floor indicating the accessible route to an ADA compliant Toilet Room.	Install Signage (Male and Female).	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance

¹⁴ Pg. 3b, I

¹⁵ Pg. 3b, H,

	In accordance with section 3.7 of the Self-Evaluation, there is not proper maneuvering clearance in the restroom.	Infeasible to Alter.	N/A	N/A	N/A	N/A
	In accordance with sections 3.9 and 3.44 of the Self-Evaluation, the door to the woman's restroom is not operable for persons with disabilities.	Replace Door Knob with Proper Door Lever.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.19 of the Self-Evaluation, the mirror is above the 40' height requirement.	Lower Mirror from 61" to 40".	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.26 of the Self-Evaluation there is no cover over the pipes.	Install Pipe Cover.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is higher than 44" from the floor.	Lower the Paper Towel Dispenser from 60" to no more than 44".	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.34 of the Self-Evaluation, there is no rear grab bar.	Install ADA Compliant Rear Grab Bar.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance to section 3.43 of the Self-Evaluation, the door is not self-closing.	Install an ADA Compliant Closer.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance

Cost Estimate for Courthouse

Phase 1: \$935.00 (\$312 a budget year for 3 years)

Phase 2: \$635.00

Phase 3: \$600.00

Total: **\$2,170.00**

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: J.P. Kennedy¹⁶

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Front side, Tag Office, and Backside, Solid Waste Area. ¹⁷	In accordance with sections 1.1 and 1.10 of the Self-Evaluation, there is no signage designating handicap accessible parking spots around the building or the necessary accessible routes to each department.	Add ADA compliant signage bearing the International Symbol of Accessibility, as well as signage locating the accessible routes for each department.	Phase 1	Maintenance Department	\$650	County Maintenance Budget: Line 599-ADA Compliance
Ramp, Rear of Building. ¹⁸	In accordance with section 1.30 of the Self-Evaluation, there are not handrails on both sides of the ramp.	Install ADA compliant handrails on the side wall.	Phase 3	Maintenance Department	\$500	County Maintenance Budget: Line 599-ADA Compliance
Side door, Finance entrance. ¹⁹	In accordance with section 1.39 of the Self-Evaluation, there is not signage at inaccessible routes, directing persons with disabilities to accessible entrances.	Add Signage to the wall beside the stairs Leading to the Finance Entrance, Indicating Accessible Routes.	Phase 2	Maintenance Department	\$30	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 2.43 of the Self-Evaluation, some doors throughout the building	Replace Knobs with Door Levers. ²⁰	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance

¹⁶ Pg. 1b, B

¹⁷ Pg. 1b, E1, E2, E3, E4

¹⁸ Pg. 1b, F - Pg. 5b, A

¹⁹ Pg. 1b, G - 6b, A

²⁰ Subject to Change Upon Security Upgrades.

	are not equipped with the proper ADA compliant Handles.					
Main Lobby (Phase 2), Basement Lobby (Phase 3), Fee Office's Countertops. ²¹	In accordance with sections 2.76, 2.77, and 2.78 of the Self-Evaluation, the counter tops do not have sections that at, at least, 36" tall and 36" long.	Reconfigure Countertops to the ADA Accessible Height and Length.	Phase 2 & 3	Maintenance Department	\$15,000.00 ²²	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Public Restroom, 1st Floor²³						
Main Lobby. ²⁴	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
Outside Men's Restroom (Beside Property Assessors Office).	In accordance with section 3.5 of the Self-Evaluation, there are not ADA compliant signage indicating the presence of a restroom.	Add ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A

²¹ Pg. 5b, H1, H2, H3 - 6b, B1, B2, B3

²² Phase 2: \$7,500, Phase 3: \$7,500

²³ Pg. 6b. C

²⁴ Pg. 6b, D

	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation, the grab bars do not extend 42" along the side or rear walls.	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A
Area: Woman's Public Restroom, 1st Floor²⁵						
Main Lobby. ²⁶	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
Outside Woman's Restroom (Beside Property Assessors Office).	In accordance with section 3.5 of the Self-Evaluation, there are not ADA compliant signage indicating the presence of a restroom.	Add ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance

²⁵ Pg. 6b, E

²⁶ Pg. 6b, D

	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation, the grab bars do not extend 42" along the side or rear walls.	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A
Area: Basement Stairwell, Men's Restroom²⁷						
Main Lobby. ²⁸	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance

²⁷ Pg. 5b, B

²⁸ Pg. 5b, C

	accessible route to the wheelchair accessible restroom.					
Outside Men's Restroom.	In accordance with section 3.5 of the Self-Evaluation, there are not ADA compliant signage indicating the presence of a restroom.	Add ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation, the grab bars do not extend 42" along the side or rear walls.	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A
Area: Basement Stairwell,						

Woman's Restroom²⁹						
Main Lobby. ³⁰	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
Outside Woman's Restroom.	In accordance with section 3.5 of the Self-Evaluation, there are not ADA compliant signage indicating the presence of a restroom.	Add ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation,	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance

²⁹ Pg. 5b, D

³⁰ Pg. 5b, C

	the grab bars do not extend 42" along the side or rear walls.					
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A
Area: Solid Waste, Men's Restroom³¹						
Main Lobby. ³²	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
Outside Men's Restroom.	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage indicating the presence of a restroom is not located in the correct place.	Reposition ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A

³¹Pg. 5b, E

³² Pg. 5b, F

	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation, the grab bars do not extend 42" along the side or rear walls.	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A
Area: Solid Waste, Women's Restroom³³						
Main Lobby. ³⁴	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
Outside Women's Restroom.	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage indicating the presence of a restroom is not located in the correct place.	Reposition ADA Compliant Signage.	Phase 1	Maintenance Department	\$20	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door takes under 5 seconds to close.	Adjust Closer to Meet the ADA Required 5 Seconds.	Phase 1	Maintenance Department	N/A	N/A

³³ Pg. 5b, G

³⁴ Pg. 5b, F

	In accordance with section 3.19 of the Self-Evaluation, the bottom of the mirror is greater than 35" from the floor.	Reposition Mirror to the ADA Maximum Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with Section 3.28 of the Self-Evaluation, the soap dispenser is greater than 44" above the ground.	Reposition Soap Dispenser between the ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 and 3.34 of the Self-Evaluation, the grab bars do not extend 42" along the side or rear walls.	Replace the Rear and Side wall Grab Bars with ADA compliant Grab Bars.	Phase 1	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.38 of the Self-Evaluation, the toilet paper dispenser is located greater than 9" from the front of the water closet (toilet).	Reposition toilet paper dispenser to ADA required area.	Phase 1	Maintenance Department	N/A	N/A

Cost Estimate for J.P. Kennedy

Phase 1: \$1415.00 (\$471.67 a budget year for 3 years)

Phase 2: \$7,530.00

Phase 3: \$8,000.00

Total: **\$16,945.00**

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Airport³⁵

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Parking Lot. ³⁶	In accordance with section 1.2 through 1.12 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces.	Phase 1	Maintenance Department	\$500	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Restroom						
Outside of Restroom.	In accordance with section 3.5 of the Self-Evaluation, the signage is not mounted on the wall.	Mount ADA Compliant Signage to the Wall at ADA Compliant Height and Distant.	Phase 1	Maintenance Department	\$25	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.9 of the Self-Evaluation, the door to the restroom does not have ADA compliant handles.	Equip Door with ADA Compliant Handles.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.19 of the Self-Evaluation, the mirror	Lower Mirror to ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A

³⁵ Pg. 7b, A

³⁶ Pg. 7b. B

	is over 40" from the bottom of the floor.					
	In accordance with section 3.28 of the Self-Evaluation, the soap dispenser is higher than the ADA compliant height.	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.33 of the Self-Evaluation, the side-wall grab-bar does not extend the proper length, nor is it mounted in the ADA compliant ranges.	Replace and Reposition Side-Wall Grab-Bar.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.34 of the Self-Evaluation, there is not a rear-wall grab-bar.	Install ADA Compliant Grab-Bar along the Rear Wall.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
Area: Women's Restroom						
Outside of Restroom.	In accordance with section 3.5 of the Self-Evaluation, the signage is not mounted on the wall.	Mount ADA Compliant Signage to the Wall at ADA Compliant Height and Distant.	Phase 1	Maintenance Department	\$25	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.9 of the Self-Evaluation, the door to the restroom does not have ADA compliant handles.	Equip Door with ADA Compliant Handles.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.12 of the Self-Evaluation, the door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.19 of the Self-Evaluation, the mirror is over 40" from the bottom of the floor.	Lower Mirror to ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.28 of the Self-Evaluation, the soap	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	County Maintenance Budget: Line 599-ADA Compliance

	dispenser is higher than the ADA compliant height.					
	In accordance with section 3.33 of the Self-Evaluation, the side-wall grab-bar does not extend the proper length, nor is it mounted in the ADA compliant ranges.	Replace and Reposition Side-Wall Grab-Bar.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance
	In accordance with section 3.34 of the Self-Evaluation, there is not a rear-wall grab-bar.	Install ADA Compliant Grab-Bar along the Rear Wall.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance

Cost Estimate for Airport

Phase 1: \$750.00 (\$250.00 a budget year for 3 years)

Phase 2: \$250.00

Phase 3: N/A

Total: **\$1000.00**

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Visitor's Center³⁷

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Parking Lot. ³⁸	In accordance with section 1.3 through 1.11 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces (4, ADA Compliant Signs).	Phase 1	Maintenance Department	\$600	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Restroom						
	In accordance with section 3.28 of the Self-Evaluation, the soap dispenser is higher than the ADA compliant height.	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
Area: Women's Restroom						
	In accordance with section 3.28 of the Self-Evaluation, the soap	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A

³⁷ Pg. 8b, A

³⁸ Pg. 8b, B

	dispenser is higher than the ADA compliant height.					
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A

Cost Estimate for Airport

Phase 1: \$600.00 (\$200.00 a budget year for 3 years)

Phase 2: N/A

Phase 3: N/A

Total: **\$600.00**

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Election Commission³⁹

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Parking Lot. ⁴⁰	In accordance with section 1.3 through 1.11 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces.	Phase 1	Maintenance Department	\$300	County Maintenance Budget: Line 599-ADA Compliance
Front Reception Area. ⁴¹	In accordance with section 2.76 of the Self-Evaluation, the counters are more that 36" from the floor.	Lower Countertops to ADA Compliant Height.	Phase 1	Maintenance Department	\$2500	County Maintenance Budget: Line 599-ADA Compliance
Area: Unisex Restroom⁴²						
	In accordance with section 3.2 of the Self-Evaluation, there is no signage indicating the direction of the ADA compliant restroom.	Add Signage.	Phase 1	Maintenance Department	\$50	County Maintenance Budget: Line 599-ADA Compliance

³⁹ Pg. 9b, A

⁴⁰ Pg. 9b, B

⁴¹ Pg. 10b, A

⁴² Pg. 10b, B

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Health Department⁴³/Dental Clinic^{44,45}

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Joint Parking Lot. ⁴⁶	In accordance with section 1.3 through 1.11 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces.	Phase 1	Maintenance Department	\$600	County Maintenance Budget: Line 599-ADA Compliance
Area: Health Department, Unisex Restroom						
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
Area: Dental Clinic, Unisex Restroom						

⁴³ Pg. 11b, A

⁴⁴ Two, independent Self-Evaluations.

⁴⁵ Pg. 11b, B

⁴⁶ Pg. 11b, C

	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
--	---	--	------------	---------------------------	-----	-----

Cost Estimate for Election Commission

Phase 1: \$2850.00 (\$950.00 a budget year for 3 years)

Phase 2: N/A

Phase 3: N/A

Total: **\$2850.00**

Cost Estimate for Health Department/Dental Clinic

Phase 1: \$600.00 (\$200.00 a budget year for 3 years)

Phase 2: N/A

Phase 3: N/A

Total: **\$600.00**

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Hwy Department-911 Center⁴⁷

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Parking Lot. ⁴⁸	In accordance with section 1.3 through 1.5 and 1.11 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces.	Phase 1	Maintenance Department	\$300	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Restroom						
	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage is not located on the wall.	Reposition Signage.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.28 of the Self-Evaluation, the soap dispenser is higher than the ADA compliant height.	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A

⁴⁷ Pg. 11b, D

⁴⁸ Pg. 11b, E

	In accordance with section 3.43 of the Self-Evaluation, the stall door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
Area: Women's Restroom						
	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage is not located on the wall.	Reposition Signage.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.28 of the Self-Evaluation, the soap dispenser is higher than the ADA compliant height.	Lower Soap Dispenser the ADA Compliant Height.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.43 of the Self-Evaluation, the stall door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance

PLAN OF IMPLEMENTATION

Monroe County, Tennessee

Building: Witt Judicial Complex⁴⁹

Phase 1: July, 2020-June, 2023

Phase 2: July, 2023-June, 2024

Phase 3: July, 2024-June, 2025

Area	Access Issue	Recommended Correction	Target Date	Personnel Responsible	Cost Estimate	Source of Funding
Parking Lot. ⁵⁰	In accordance with section 1.3 through 1.5 and 1.11 of the Self-Evaluation, there is not a van accessible handicap space, nor appropriate area spacing or signage.	Add Signage and Reconfigure Spaces.	Phase 1	Maintenance Department	\$300	County Maintenance Budget: Line 599-ADA Compliance
Courtroom. ⁵¹	In accordance with section 2.52 of the Self-Evaluation, there is no designated wheelchair space in the Courtroom. ⁵²	Designate Wheelchair space in Courtroom.	Phase 3	Maintenance Department	\$500	County Maintenance Budget: Line 599-ADA Compliance
Area: Men's Restroom⁵³						
	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	N/A	N/A

⁴⁹ Pg. 12b, A

⁵⁰ Pg. 12b, B

⁵¹ Pg. 13b, A

⁵² Subject to Change upon Transition into Justice Center.

⁵³ Pg. 13b, B

	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage is not located on the wall.	Reposition Signage.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.43 of the Self-Evaluation, the stall door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
Area: Women's Restroom⁵⁴						
	In accordance with section 3.2 of the Self-Evaluation, there are no signs indicating the accessible route to the wheelchair accessible restroom.	Add Appropriate Signage.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.5 of the Self-Evaluation, the ADA compliant signage is not located on the wall.	Add Signage.	Phase 1	Maintenance Department	N/A	N/A
	In accordance with section 3.29 of the Self-Evaluation, the paper towel dispenser is greater than 44" from the floor.	Reposition Paper Towel Dispenser between ADA Required Heights.	Phase 1	Maintenance Department	N/A	N/A

⁵⁴ Pg. 13b, C

	In accordance with section 3.43 of the Self-Evaluation, the stall door does not have a closer.	Install Closer.	Phase 2	Maintenance Department	\$75	County Maintenance Budget: Line 599-ADA Compliance
--	--	-----------------	------------	---------------------------	------	--

Cost Estimate for Hwy Department/911 Center

Phase 1: \$300.00 (\$100.00 a budget year for 3 years)

Phase 2: \$150.00

Phase 3: N/A

Total: **\$450.00**

Cost Estimate for Witt Judicial Complex

Phase 1: \$300.00 (\$100.00 a budget year for 3 years)

Phase 2: \$150.00

Phase 3: \$500.00

Total: **\$950.00**

Total Cost Estimate for ADA Transition Plan

Phase 1: \$7,750.00 (\$2584.00 a budget year for 3 years)

Phase 2: \$8,715.00

Phase 3: \$9,100.00

Total: **\$25,565.00**

GIS SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Courthouse and J.P. Kennedy Aerial View



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee


Building: Courthouse-Basement



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee


Building: Courthouse-1st Floor

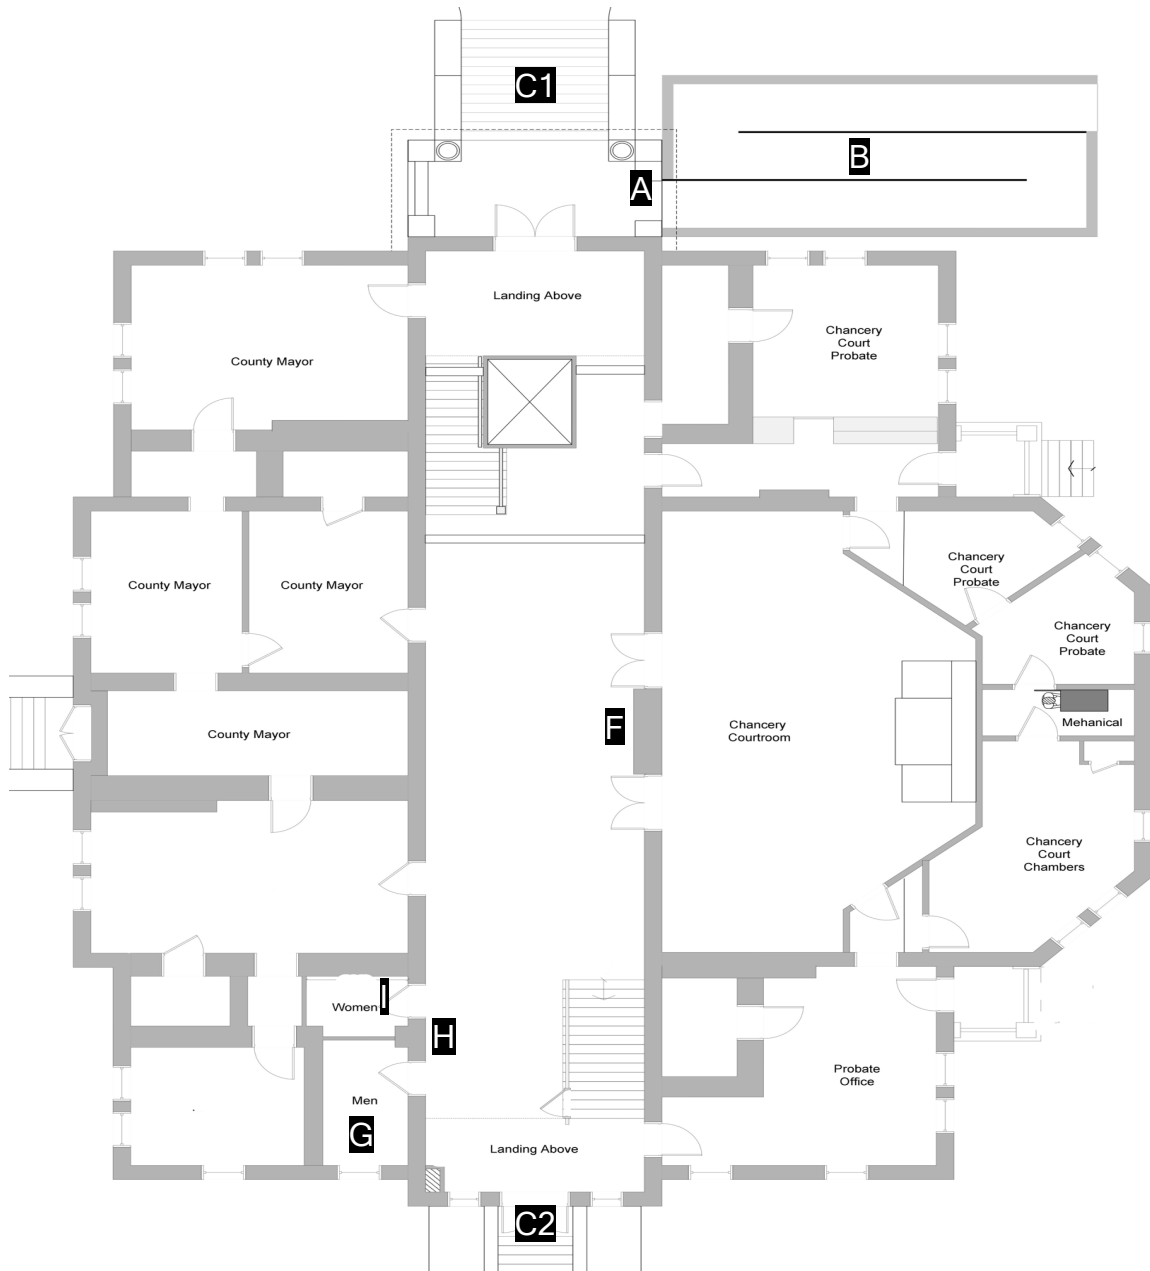

G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Courthouse-2nd Floor

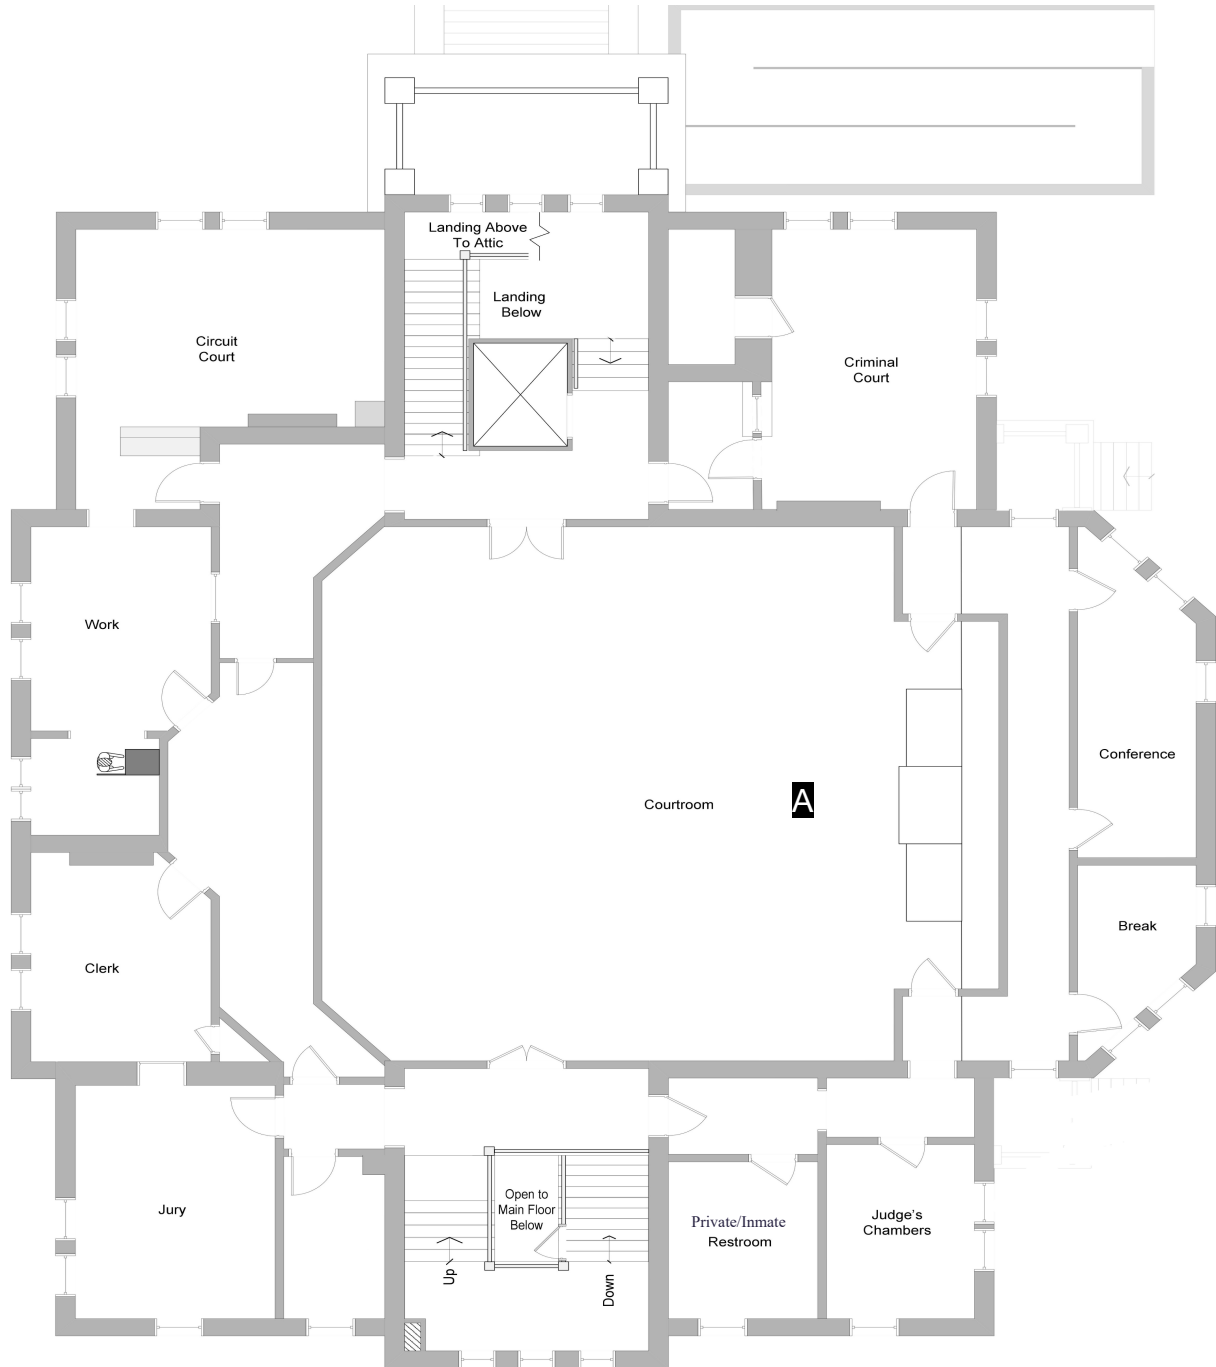

G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: J.P. Kennedy-Basement



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: J.P. Kennedy-1st Floor



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee
Building: Airport Aerial View



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Visitor Center Aerial View




— Equals County Owned Boundaries

G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee


Building: Election Commission Aerial View

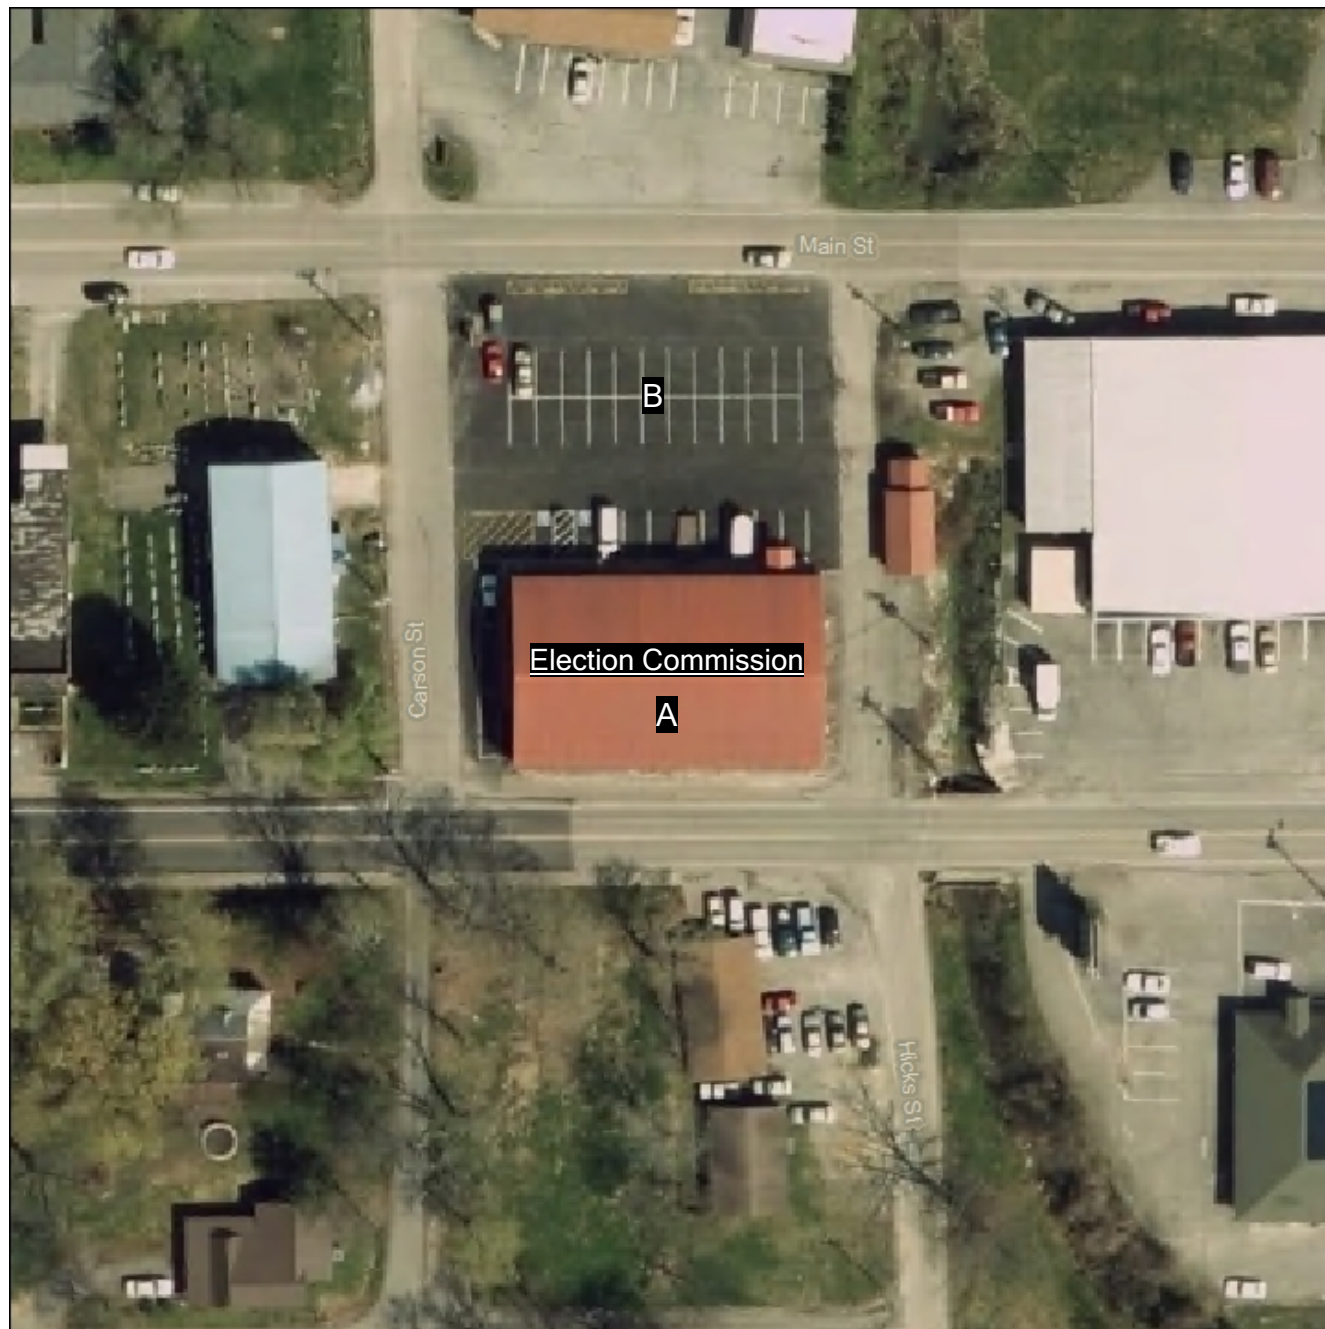

G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Election Commission

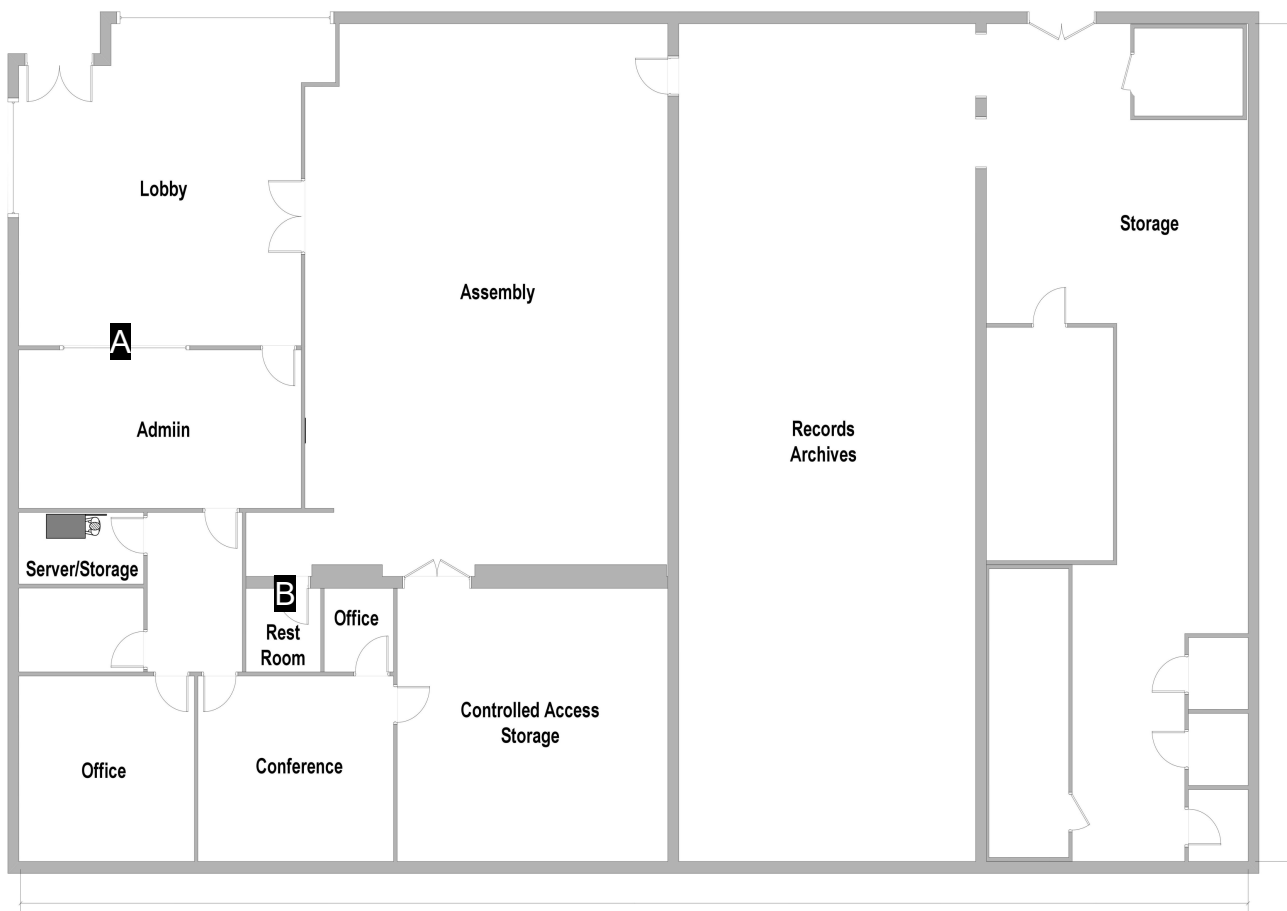

G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Hwy Department/911 Center and Health
Department/Dental Clinic Aerial View



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Witt Judicial Complex Aerial View



G.I.S. SURVEYS AND DRAWINGS

Monroe County, Tennessee

Building: Witt Judicial Complex

